

This copy has been made by or with the authority of Scottish and Southern Energy Limited (the 'Company') in accordance with the provisions of the Copyright, Designs and Patents Act 1988 (the 'Act'). Unless the Act provides to the contrary, this copy must not be copied without prior written permission from the Company.

BASED UPON THE ORDINANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CORONA COPYRIGHT RESERVED. ALL RIGHTS RESERVED.

SSSI DATA (c) Scottish Natural Heritage

ScotRail and Glasgow City Council are registered in Scotland No. 19716. Registered Office: International House, 400 Pitt Street, Glasgow, G1 1AA.

P32 Upper Boreland
TAYSIDE & CENTRAL
Tel: 01738 453072
All Voltages
Scale : 1:5000
07/10/2013
NN93651299
UNCONTROLLED COPY
Subject to revision without notice.
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID.
FOOTPATH 0.40m 0.45m 0.60m 0.75m
ROAD CROSSING 0.65m 0.60m 0.75m 0.90m
l.v./services -upto 1000V
-over 1000V to 11,000V
h.v. -22,000V and 132,000V

**WARNING**


This map shows the location of overhead lines and cables in the vicinity of the plot. It is not intended to be used as a guide to the location of overhead lines and cables. It is the responsibility of the user of this map to check no further information exists at 1:500 scale.

For plots at 1:10000 scale there may be more information visible at 1:500 scale. Responsibility is with the user of this map to check no further information exists at 1:500 scale.

**WARNING**

EHV CABLES & LINES IN PLOT AREA

MAJOR PIPELINE WITHIN 50M VICINITY CONTACT [WWW.LINESEARCH.ORG](http://WWW.LINESEARCH.ORG) OR PIPELINE OPERATOR. (OTHERS MAY EXIST)

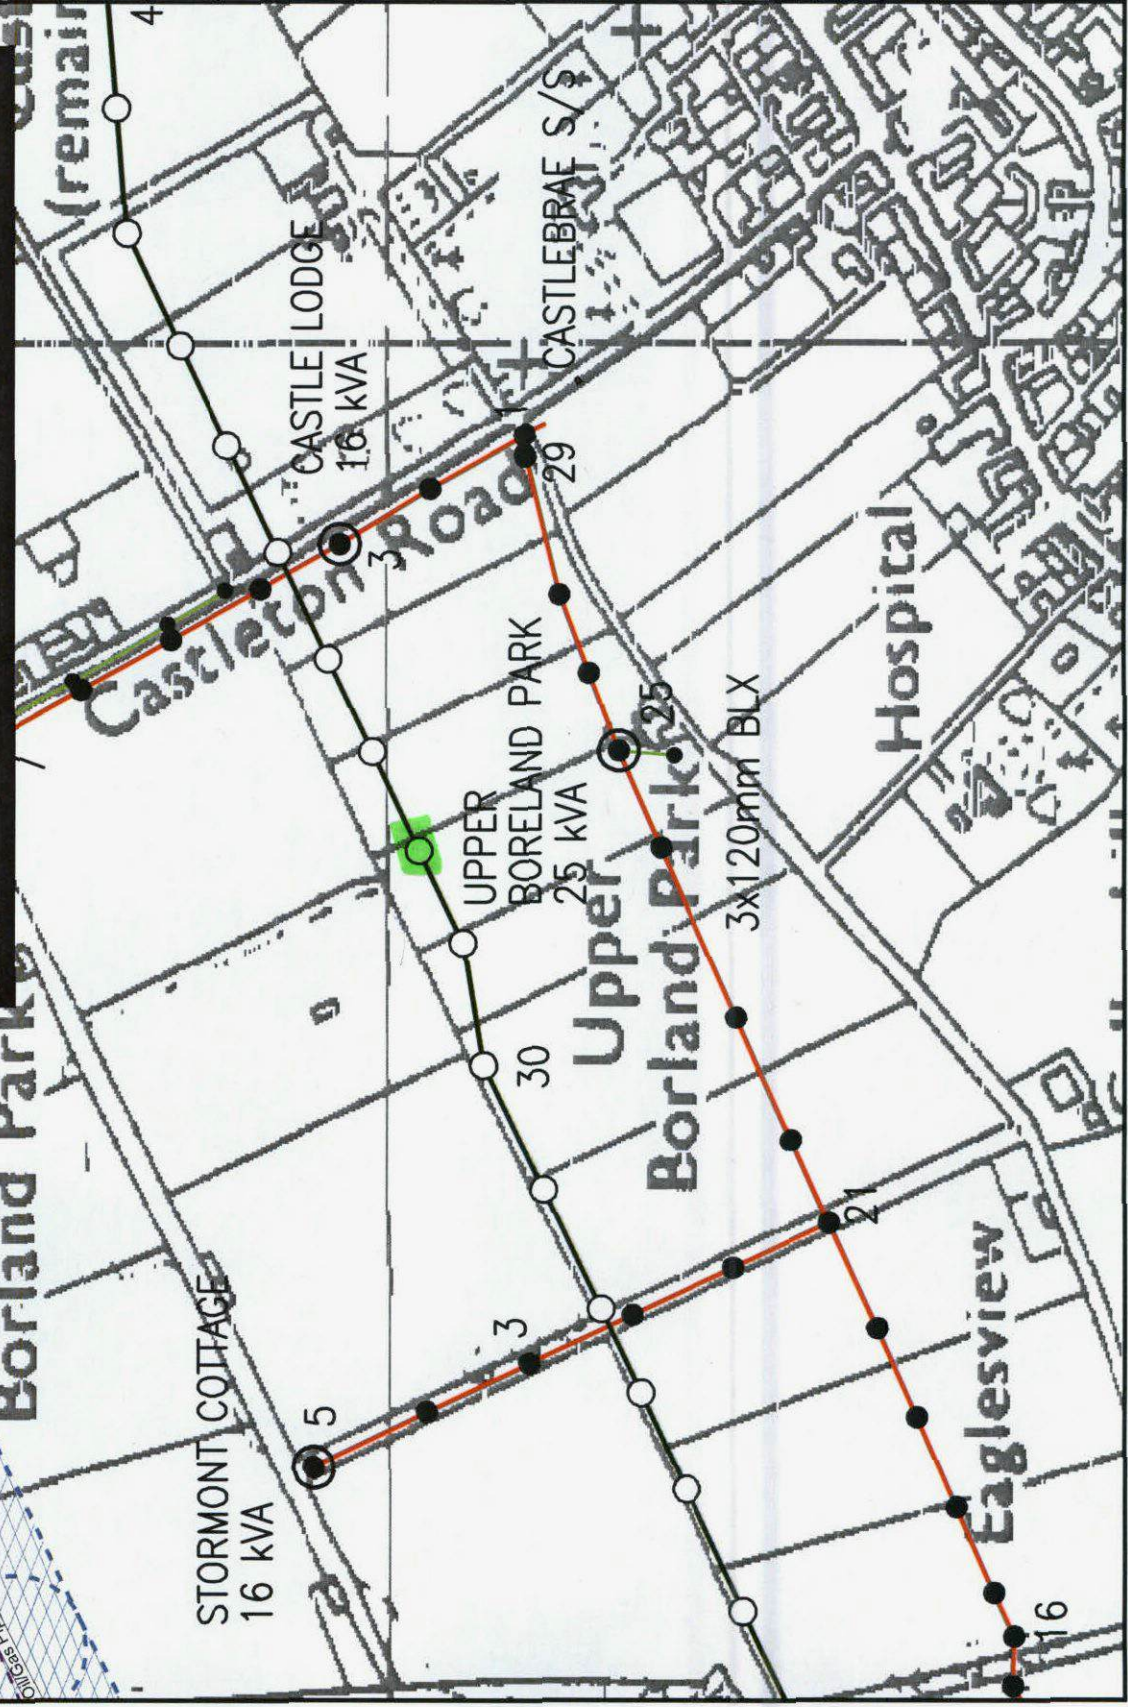

**Scottish and Southern Energy**

This copy has been made by or with the authority of Scottish and Southern Energy Limited (the Act), unless the Act provides a relevant exception to copyright, the copy must not be copied without prior written permission of Scottish and Southern Energy Limited.

BASED UPON THE ORDINANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE: CORONA COPYRIGHT REPRODUCED. Scottish and Southern Energy Limited, 197/198, Regent Street, Glasgow G2 3JF. Registered Office: Investment House, 200 Dundas Street North, PA1 2AQ.

P185

TAYSIDE & CENTRAL

Tel: 01738 453072

All Voltages

Scale : 1:5000

01/11/2013

N004221785

UNCONTROLLED COPY  
Subject to revision without notice.

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID.

FOOTPATH 0.40m 0.45m 0.60m 0.75m

ROAD CROSSING 0.65m 0.60m 0.75m 0.90m

l.v./services - upto 1000V  
- over 1000V to 11,000V  
h.v.  
- 22,000V and 132,000V e.h.v.

**WARNING**

These plots have been submitted, attention to the surface levels. These levels must be taken to determine positions and depths of cables. All (G) Symbols from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. (available from HSE)

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY COMMISSIONERS SHOULD BE CONSIDERED. (AVAILABLE FROM HSE)

For plots at 1:10000 scale there may be more information visible at 1:500 scale. Responsibility is with the user of this map to check no further information exists at 1:500 scale.

